


1,000 GALLON OUTDOOR IN-GROUND GREASE INTERCEPTOR

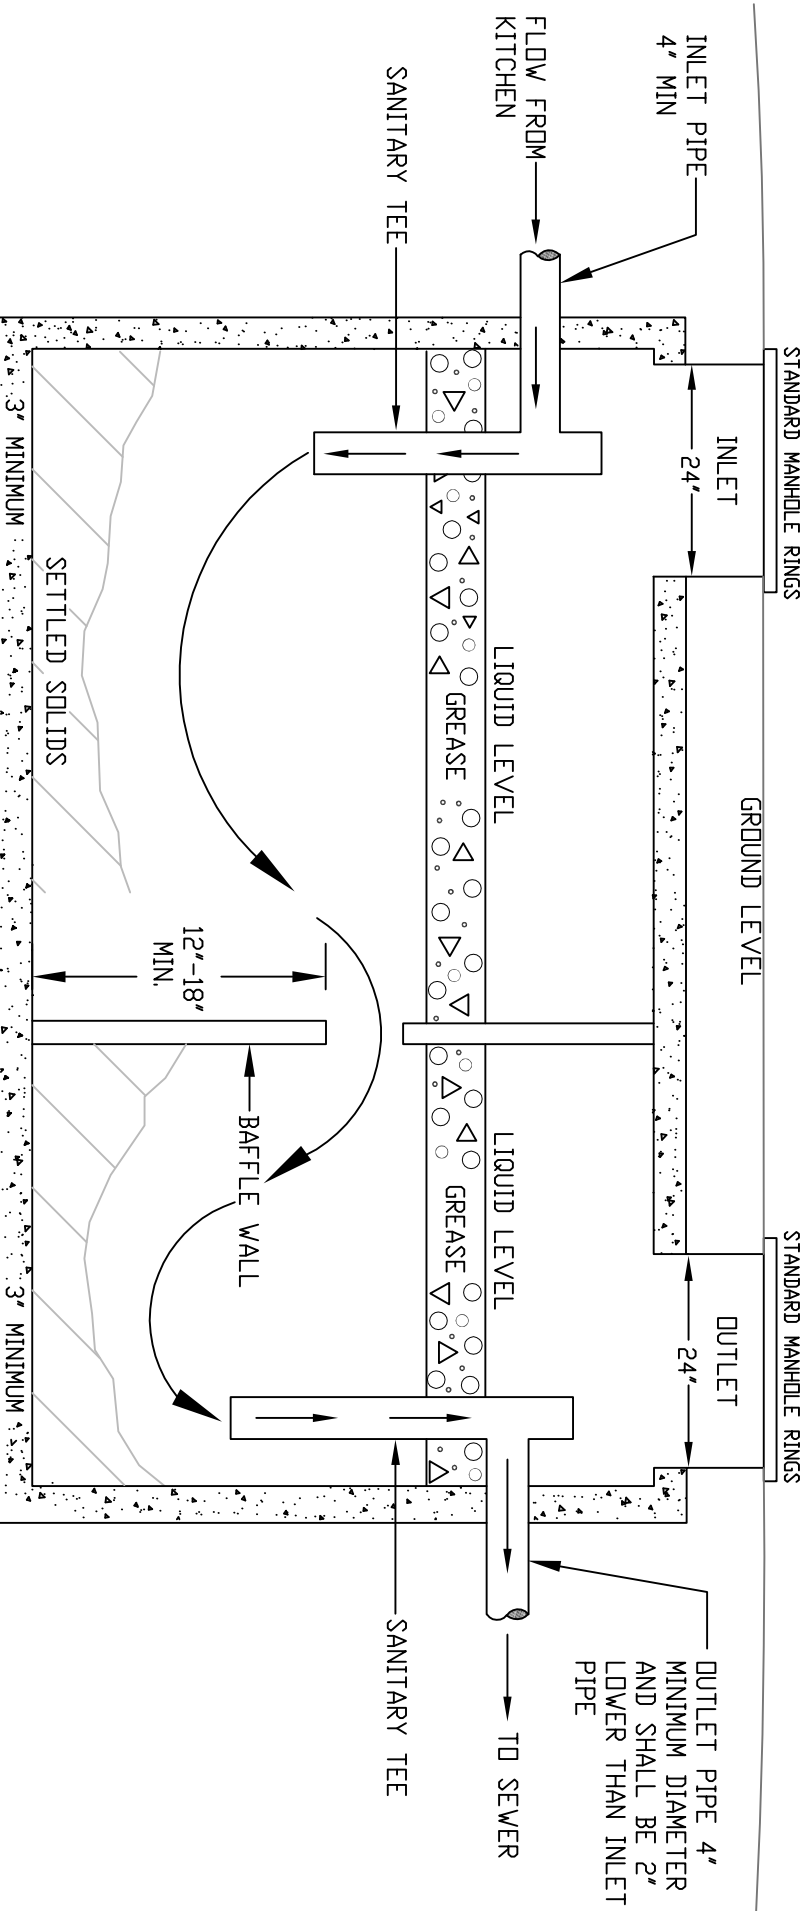

NOTES :

SIDE VIEW

- (1) THIS IS THE SMALLEST TRAP TO BE INSTALLED. TRAPS SHALL BE SIZED FOR MINIMUM 30 MINUTES DETENTION TIME BASED ON AVERAGE DAILY FLOW.
- (2) FIBERGLASS OR 4" BRICK COULD BE USED FOR THE BAFFLE.
- (3) GREASE TRAP SHALL BE LOCATED SO AS TO BE ACCESSIBLE FOR CLEANING
- (4) INLET AND OUTLET SANITARY TEES SHOULD BE OPEN AT TOP TO ALLOW VENTING
- (5) 2' ELEVATION DIFFERENCE BETWEEN INLET AND OUTLET INVERTS
- (6) FLOW THROUGH SECTION IN BAFFLE WALL SHOULD BE A MINIMUM OF 12" - 18" OFF BOTTOM
- (7) ANY VARIANCE FROM THIS DETAIL MUST HAVE PRIOR APPROVAL FROM THE CITY OF SALISBURY

CITY OF SALISBURY, N.C. STANDARD DETAIL

DATE: OCTOBER 17, 2006

SEWER SYSTEMS

NOT TO SCALE

GREASE TRAP

STANDARD

SS-8